

# BREWER'S STATION

## MASTER SEWER PLAN




- LEGEND
- EXISTING SANITARY FORCE MAIN
  - PROPOSED 8" GRAVITY SEWER
  - PROPOSED GRAVITY SEWER MANHOLE
  - PUMP STATION SERVICE AREA
  - PROPOSED PUMP STATION SITE

- NOTES:
- ALL PRE IS 8" UNLESS SHOWN OTHERWISE.
  - MINIMUM PIPE SLOPE IS 0.40% FOR 8" PVC PIPE.
  - ALL PRE IS STANDARD PVC EXCEPT AT THE FOLLOWING, WHICH SHALL BE DUCTILE IRON:
    - A. PUMP STATION CONNECTION
    - B. BREWER'S NECK BLVD. CROSSINGS
    - C. BREWER'S NECK BLVD. CULVERT CROSSING

# EXHIBIT 'E'

DATE: 11.01.13

GRAPHIC SCALE

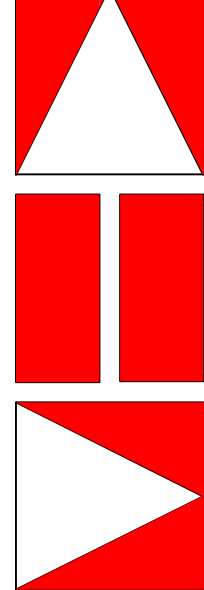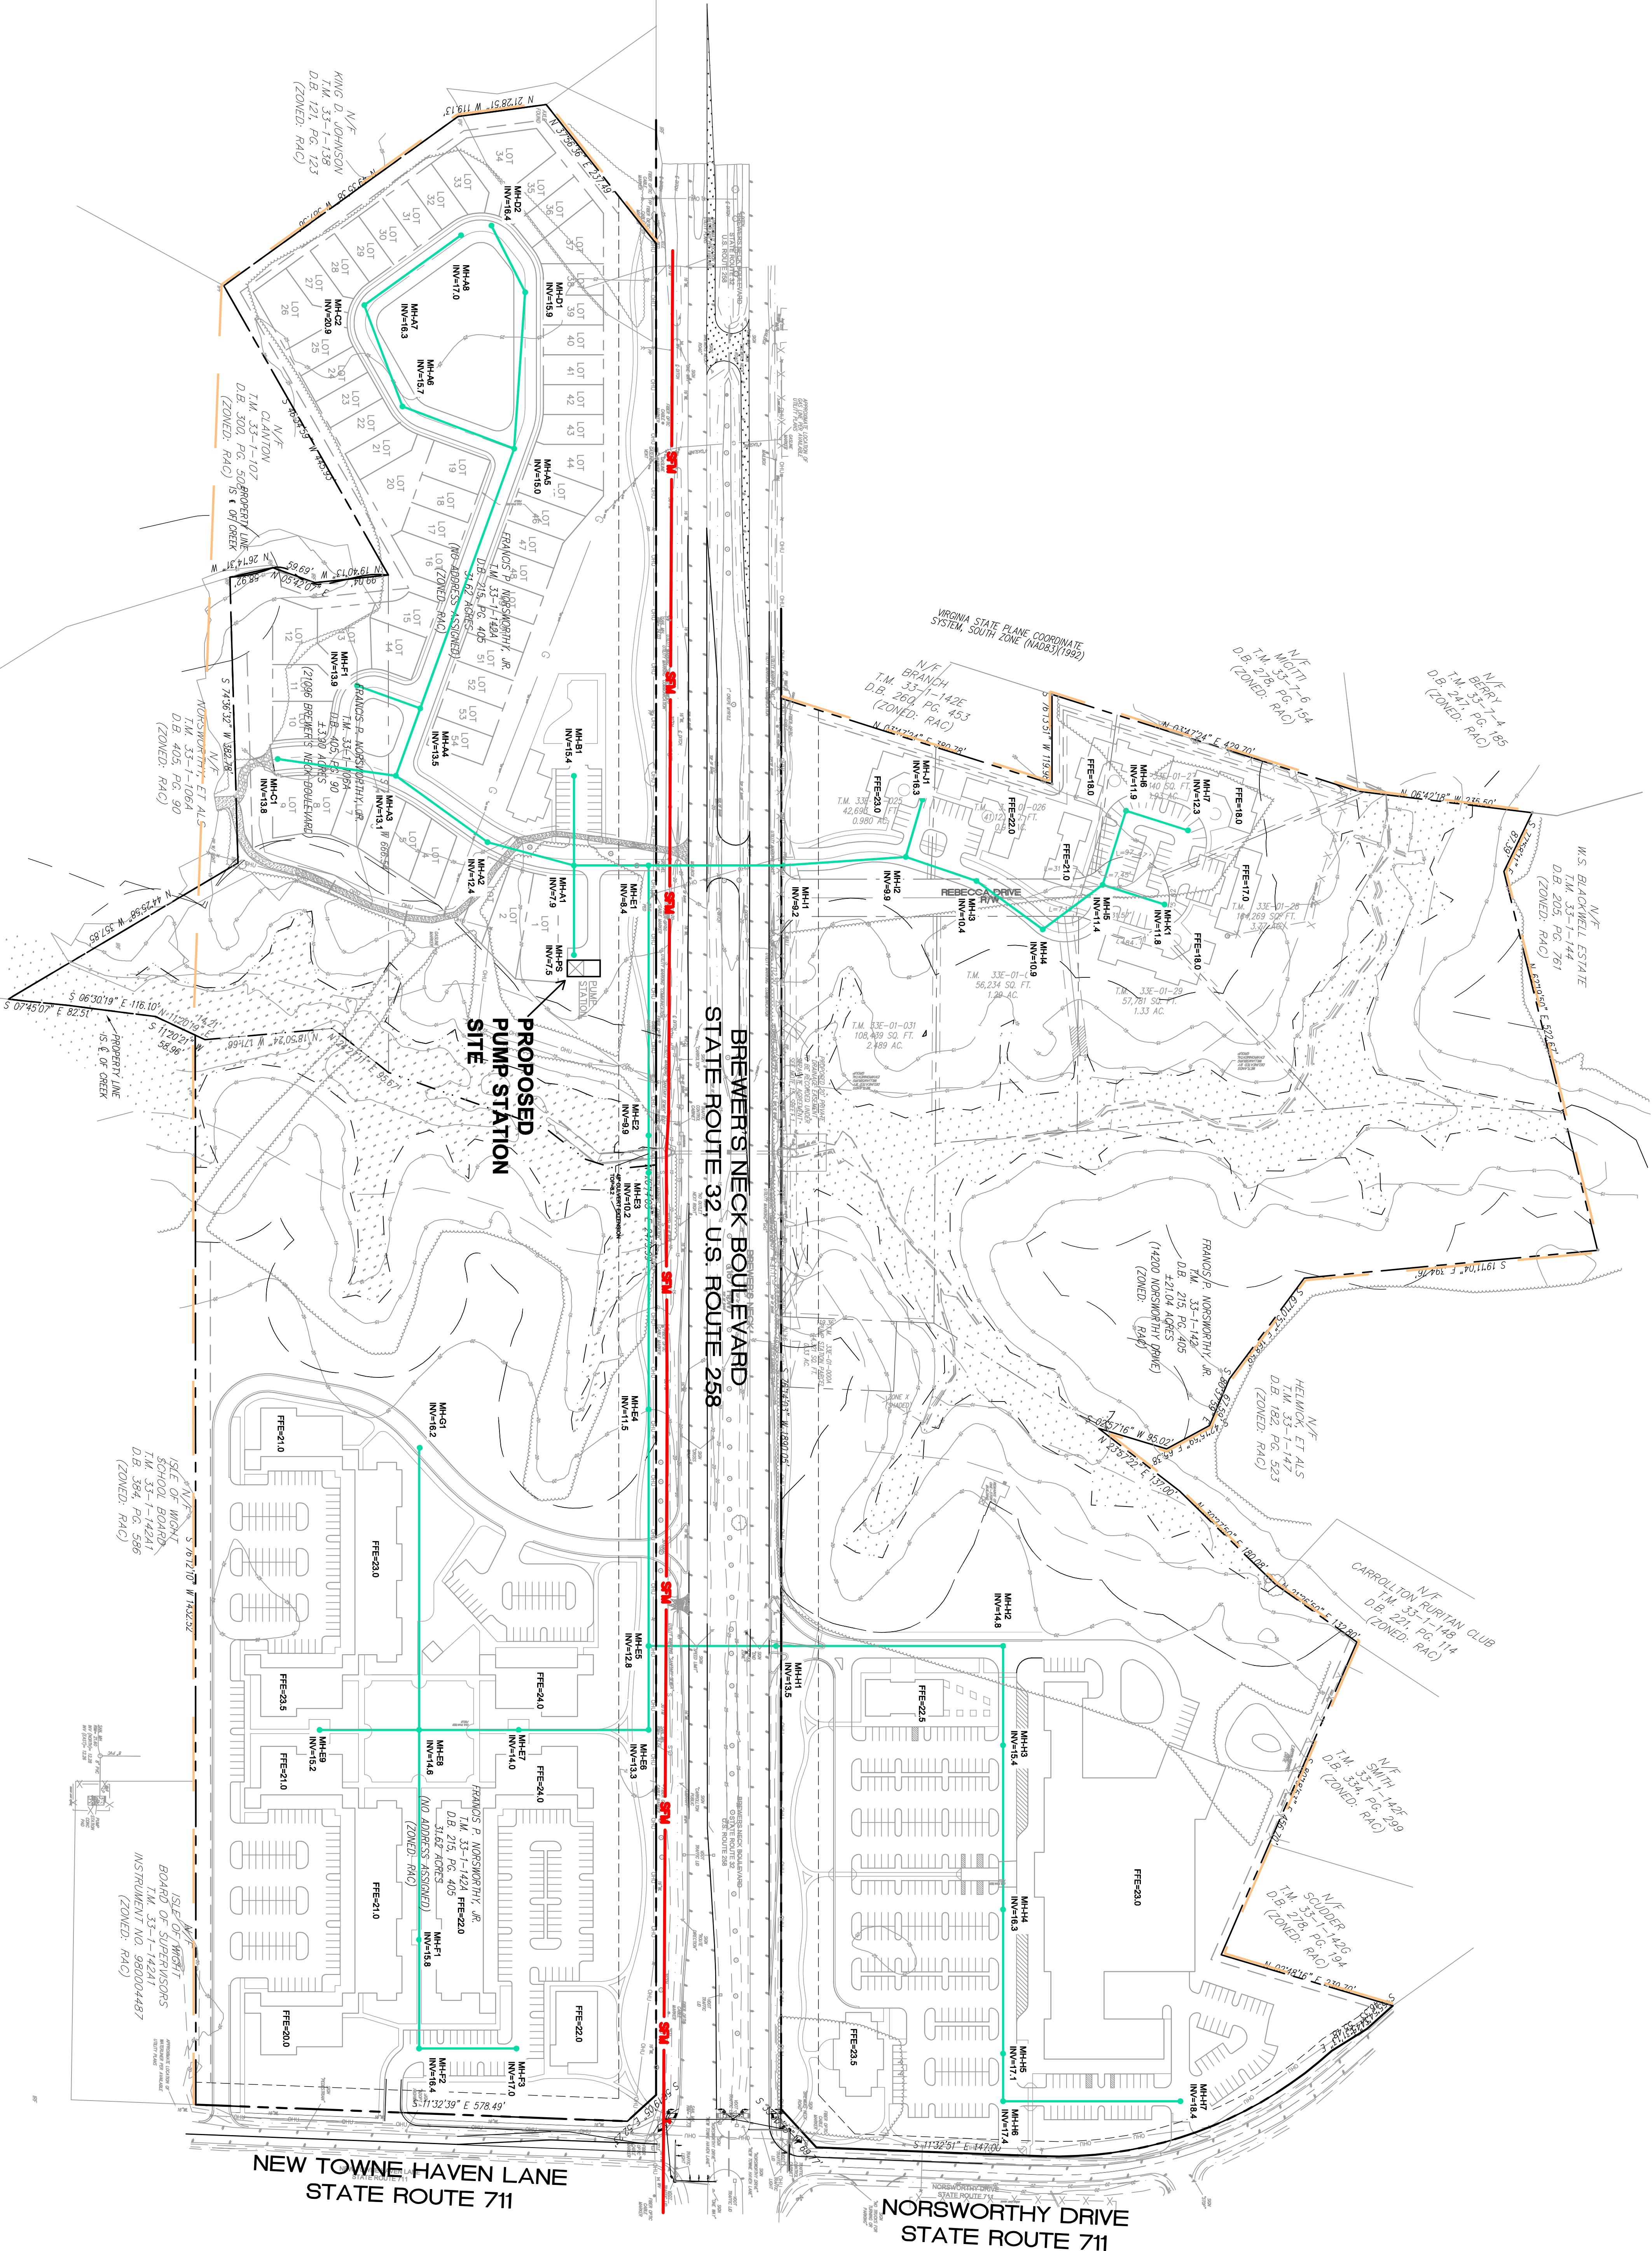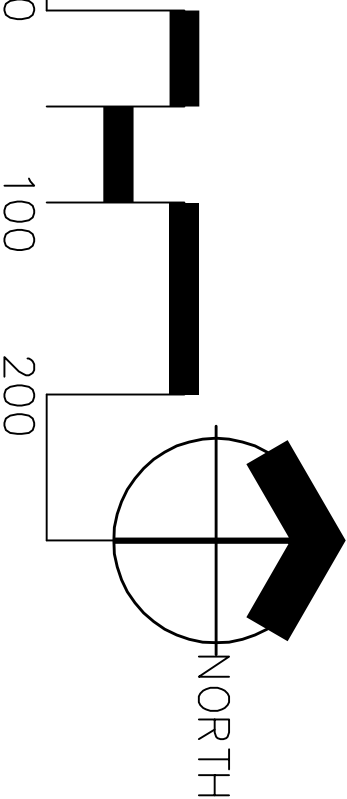

Kimley-Horn  
and Associates, Inc.

4500 Main Street, Suite 500  
Virginia Beach, Virginia 23462  
Tel. No. (757) 213-8600